

THE PARTY IN CHARGE OF THE TRENCHING ALSO HAS THE FOLLOWING RESPONSIBILITIES IN ORDER TO MAINTAIN A SAFE AND EFFECTIVE UNDERGROUND CABLE INSTALLATION

1.) SCHEDULED URE TRENCH / CONDUIT INSPECTION MUST BE AT LEAST 2 DAYS IN ADVANCE. FAILURE TO PROPERLY COORDINATE THIS WORK WITH URE MAY RESULT IN ADDITIONAL TRIP CHARGES(S) AND/OR ADDITIONAL EXCAVATION COSTS TO THE CUSTOMER. URE SHALL DETERMINE THE ROUTING OF THE TRENCH

2.) NOTIFY OHIO UTILITIES PROTECTION SERVICE (OUPS) 800-362-2764 AT LEAST TWO WORKING DAYS PRIOR TO TRENCHING. THIS ALLOWS TIME TO LOCATE EXISTING UNDERGROUND FACILITIES.

3.) ENTIRE TRENCH ROUTE MUST BE AT LEAST 36 INCHES MINIMUM DEPTH.

4.) CLEARING OF ALL DEBRIS AND STONE FROM THE OPEN TRENCH.

5.) REPAIRING OR RETRENCHING CAVE-INS ETC. AS REQUIRED BY URE

6.) IF DITCH IS NOT ADEQUATE WHEN A LINE CREW ARRIVES, A TRIP CHARGE ACCORDING TO THE COOPERATIVE'S TERMS AND CONDITIONS FOR SUPPLYING ELECTRIC SERVICE WILL BE ASSESSED.

7.) THE PROPERTY OWNER/EXCAVATOR HAS FULL RESPONSIBILITY FOR REPAIRING CUT/DAMAGED DRAIN TILE OR ANY UNDERGROUND FACILITIES SUCH AS WATER LINES, LEACH BEDS, ELECTRICAL LINES, ETC.

8.) HAND DIG AREAS WHICH ARE WITHIN 2' OF URE OWNED EQUIPMENT.


9.) CALL (937) 642-18-26 OR (800) 642-1826 FOR ADDITIONAL INFORMATION AS NECESSARY.


10) CONDUIT TO HAVE A MINIMUM PITCH OF 1 INCH PER 10 FEET.

11) INSTALL CONDUIT MARKERS AT ENDS.

12) CAP CONDUIT ENDS.

13) BACKFILL PER GOVERNMENT AUTHORITY OR COMPACTED GRANULAR BACKFILL TO BE MACHINE TAMPED WITH EVERY 6 INCHES OF RISE USING ODOT 304 CRUSHED AGGREGATE.

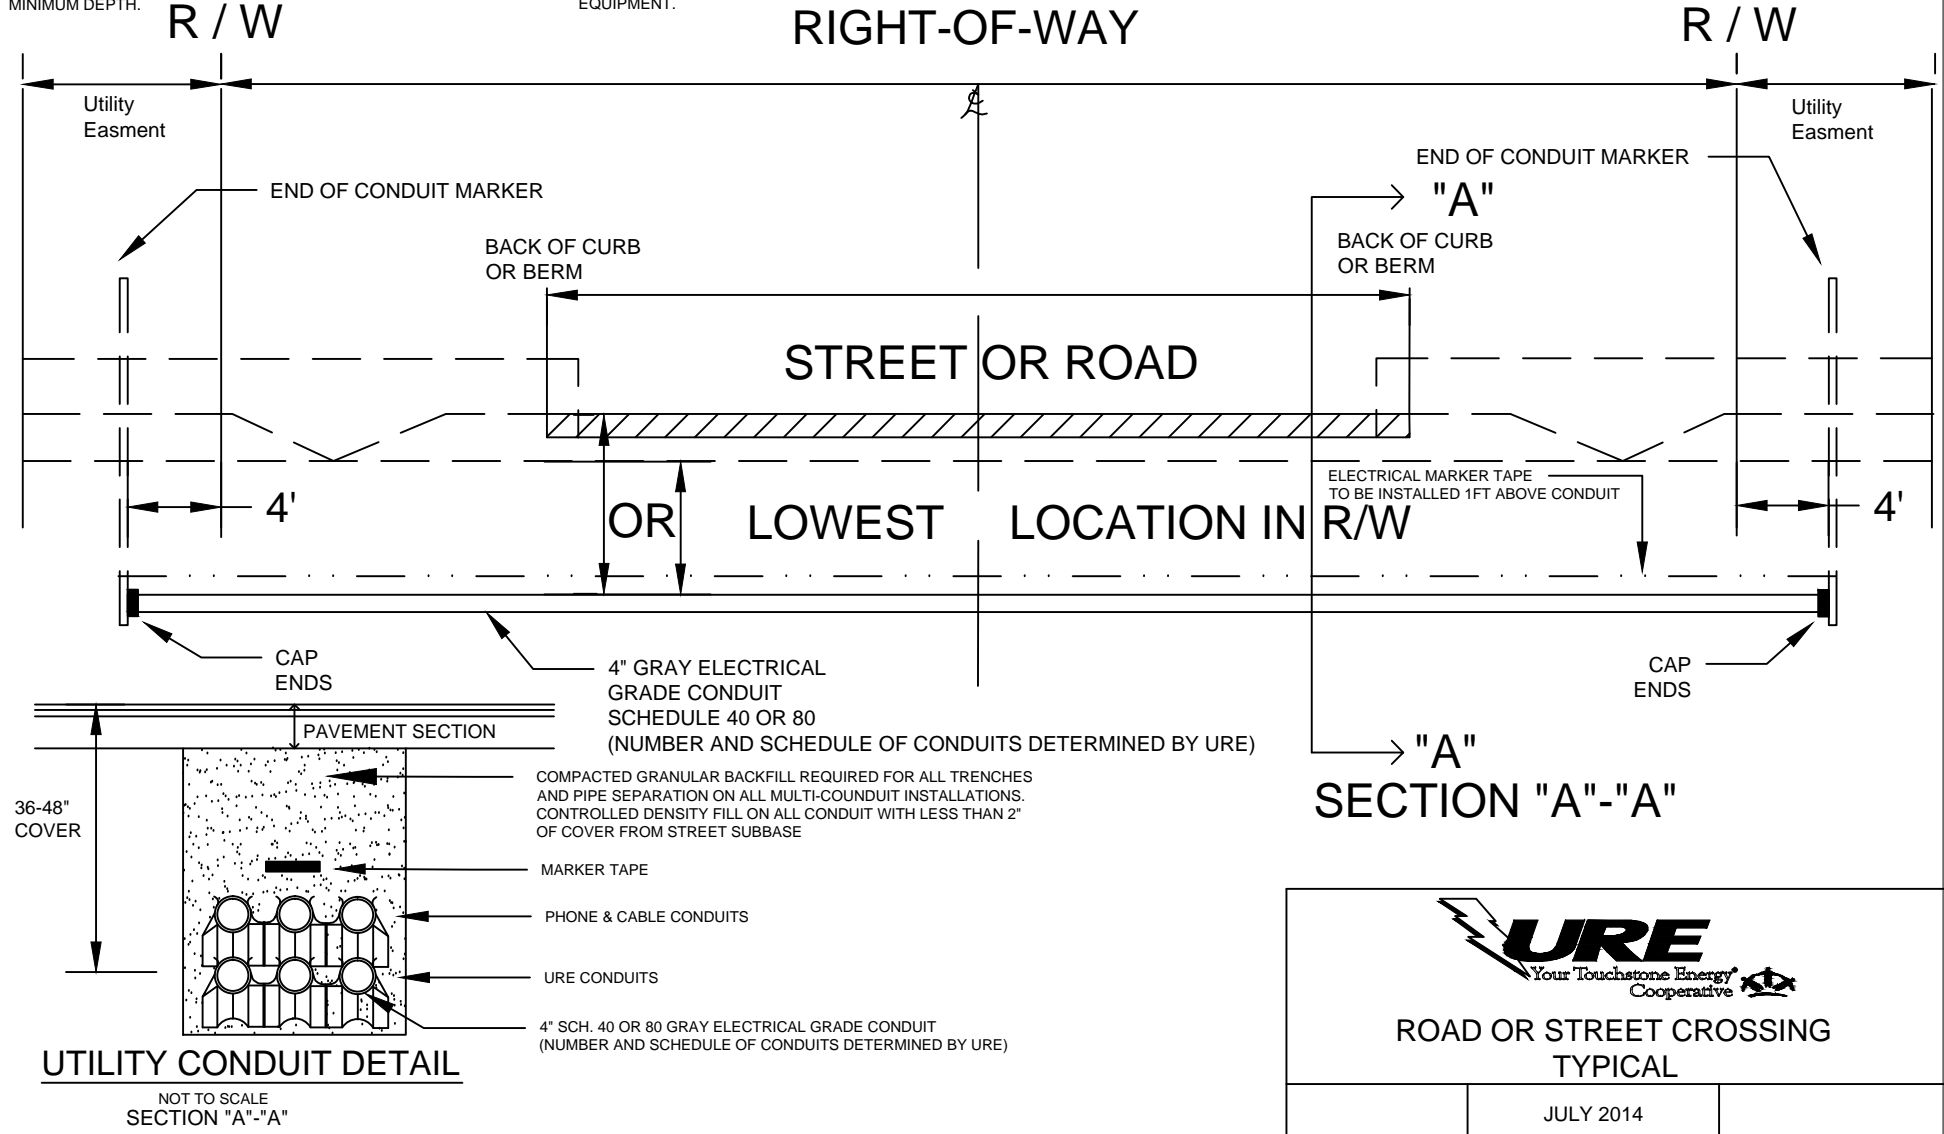



**ROAD OR STREET CROSSING
TYPICAL**

	JULY 2014	
--	-----------	--